


Sample Fireworks Site Plan

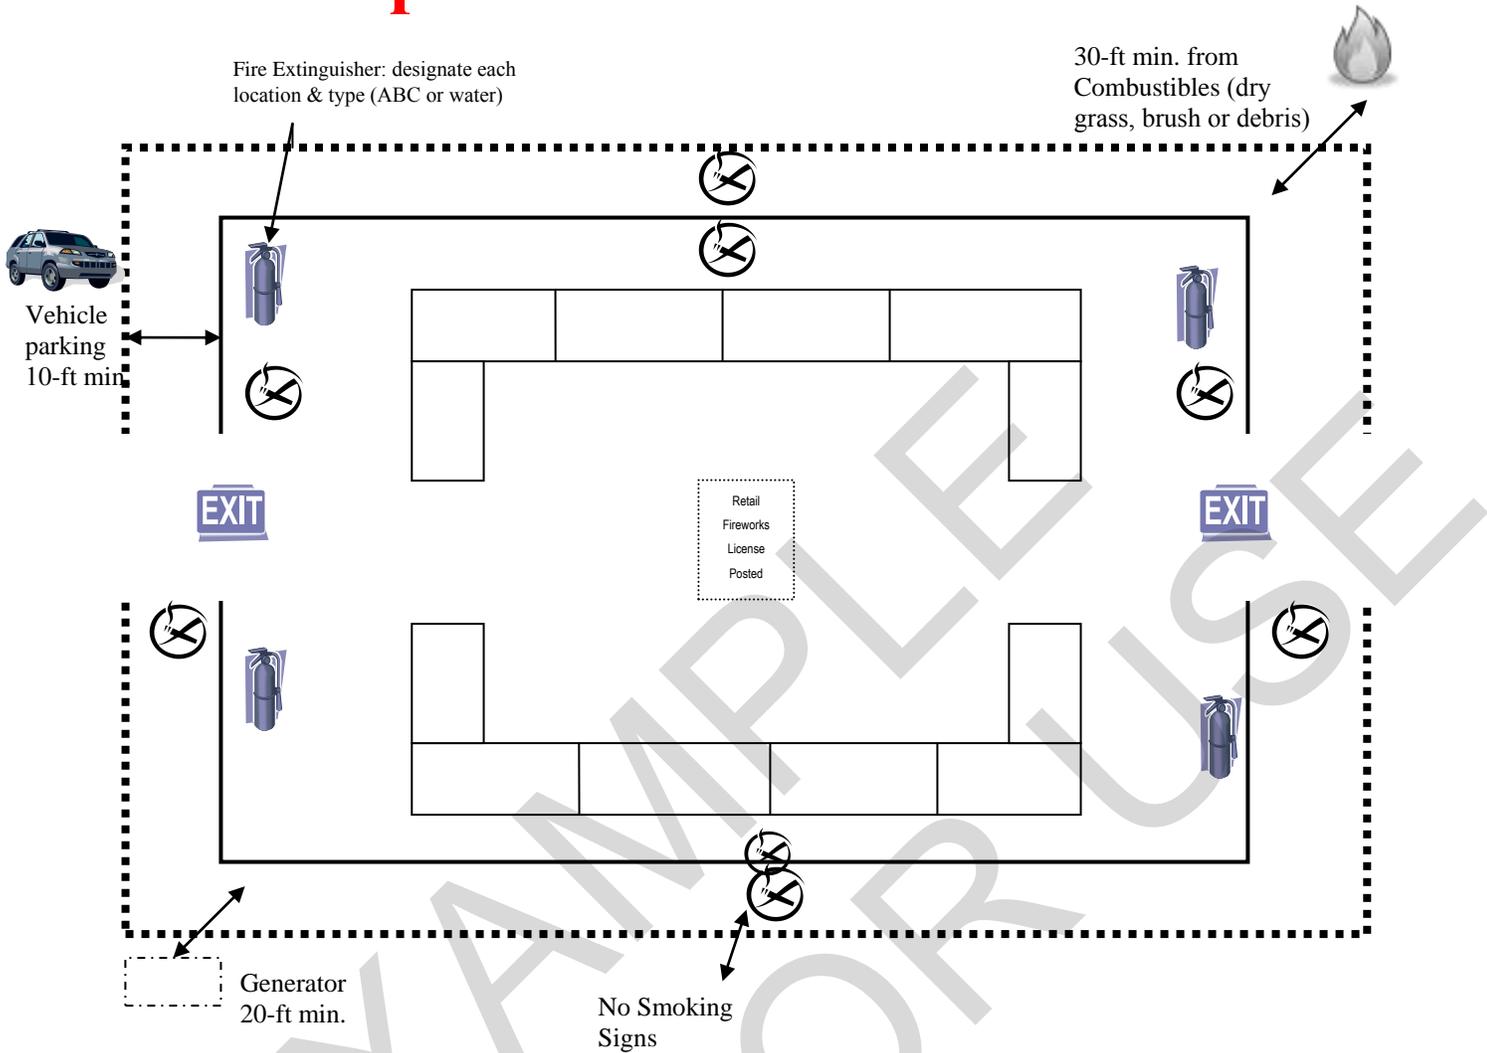

Site plan checklist: dimensioned site plan (not to scale) of the exterior and interior showing the following:

*****NOTE: This is only an illustration of what information is needed for a site plan review.*****

Exterior Site Plan

- No Smoking within 50 ft
- Storage of consumer fireworks at least:
 - 10 ft from a permanent site
 - 20 ft from a temporary site
 - 10 ft from a wheeled container
- Fire department access road within 150 ft
- Vehicle parking at least 10 ft away
- Generator at least 20 ft away
- Combustibles (dry grass, brush, debris, etc.) at least 30 ft away
- Site at least 50 ft from a fuel (gas) pumps (motor vehicle, aboveground storage tank, etc.).
- Site at least 300 ft from **bulk** fuel storage (farmer's co-op, pipeline station, etc.)
- Have fire sprinkler system (yes/no)
- Have fire alarm system (yes/no)
- Have smoke and heat venting (yes/no)
- Interior ceiling height

Interior Site Plan

- No Smoking Signs
- Fire extinguisher locations & type (ABC or water)
- Location and width of exits
- Exit signs
- Emergency exit lighting
- Max. egress travel distance
- Sq. Ft. of total floor area
- Sq. Ft. of total retail floor area
- Sq. Ft. of fireworks display floor area
- Size dimensions of display racks
- Aisle layout and widths

ONLY SINGLE STORY SITES PERMISSIBLE

Permanent stores refer to NFPA 1124, 2006 edition, section 7.5.1.2 (4) regarding specific display requirements for aerial and audible ground devices (Annex: C.3.1.2 & C.3.1.3).